


2 COMPARTMENT 2,700 GALLON POLYETHYLENE SEPTIC TANK

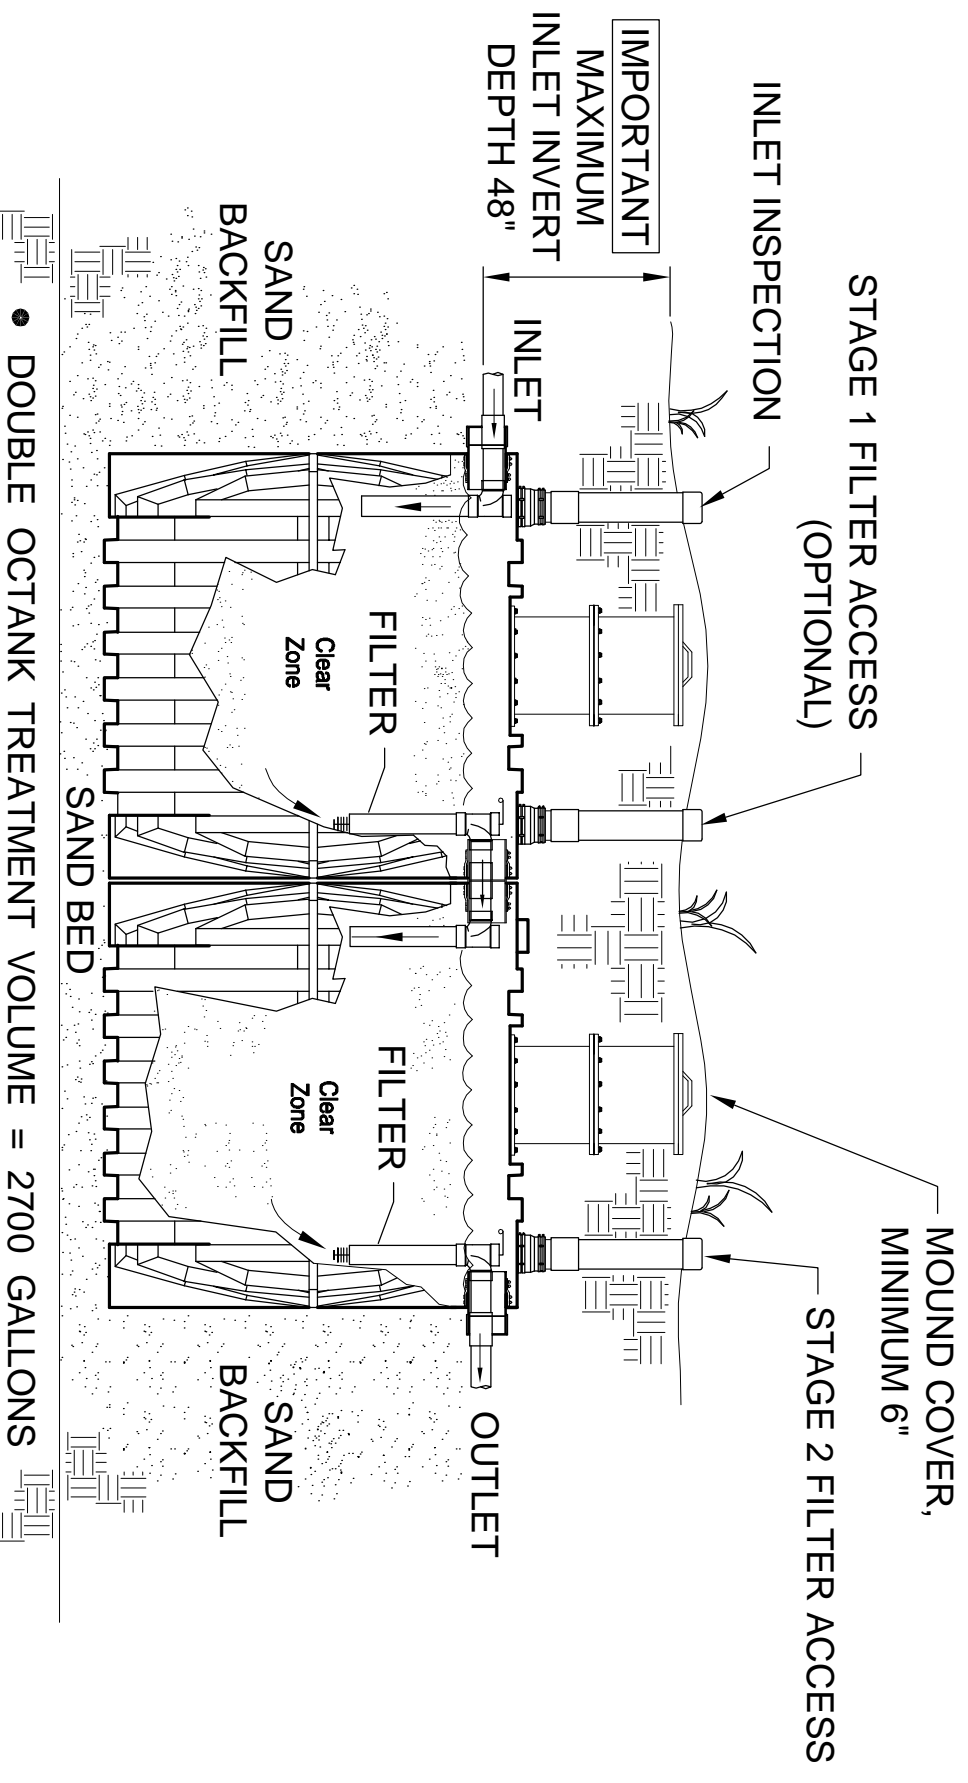

- DOUBLE OXTANK TREATMENT VOLUME = 2700 GALLONS
- 1800 GALLONS (2/3) + 900 GALLONS (1/3)
- TRADITIONAL (2) COMPARTMENT DESIGN RATIO

WARNING
WASTEWATER SYSTEMS MUST BE APPROVED IN ADVANCE BY THE LOCAL PUBLIC HEALTH DEPARTMENT PRIOR TO INSTALLATION.

Darco Inc.
 All Rights Reserved
 9/14/07