


3 COMPARTMENT 5,400 GALLON POLYETHYLENE SEPTIC TANK

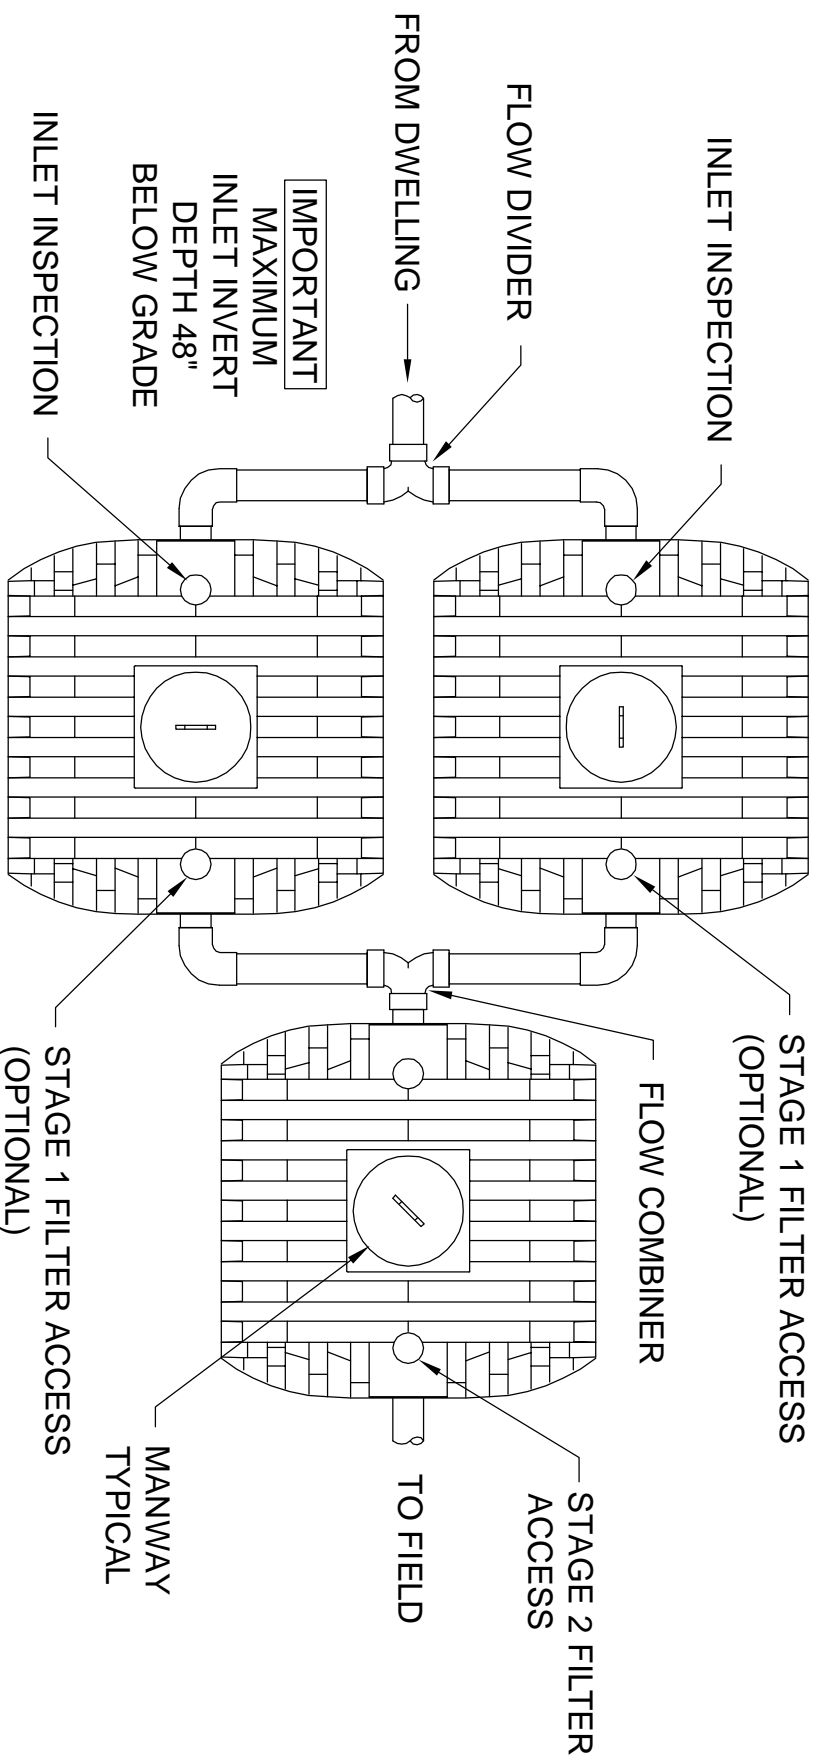

- TRIPLE OCTANK TREATMENT VOLUME = 5400 GALLONS
- 3600 GALLONS (2/3) + 1800 GALLONS (1/3)
- TRADITIONAL (2) COMPARTMENT DESIGN RATIO

⚠ WARNING
WASTEWATER SYSTEMS MUST BE APPROVED IN ADVANCE BY THE
LOCAL PUBLIC HEALTH DEPARTMENT PRIOR TO INSTALLATION.

NOT TO SCALE, FOR ILLUSTRATION ONLY