


2 COMPARTMENT 2,700 GALLON POLYETHYLENE SEPTIC TANK



- DOUBLE OCTANK TREATMENT VOLUME = 2700 GALLONS
- 1800 GALLONS (2/3) + 900 GALLONS (1/3)
- TRADITIONAL (2) COMPARTMENT DESIGN

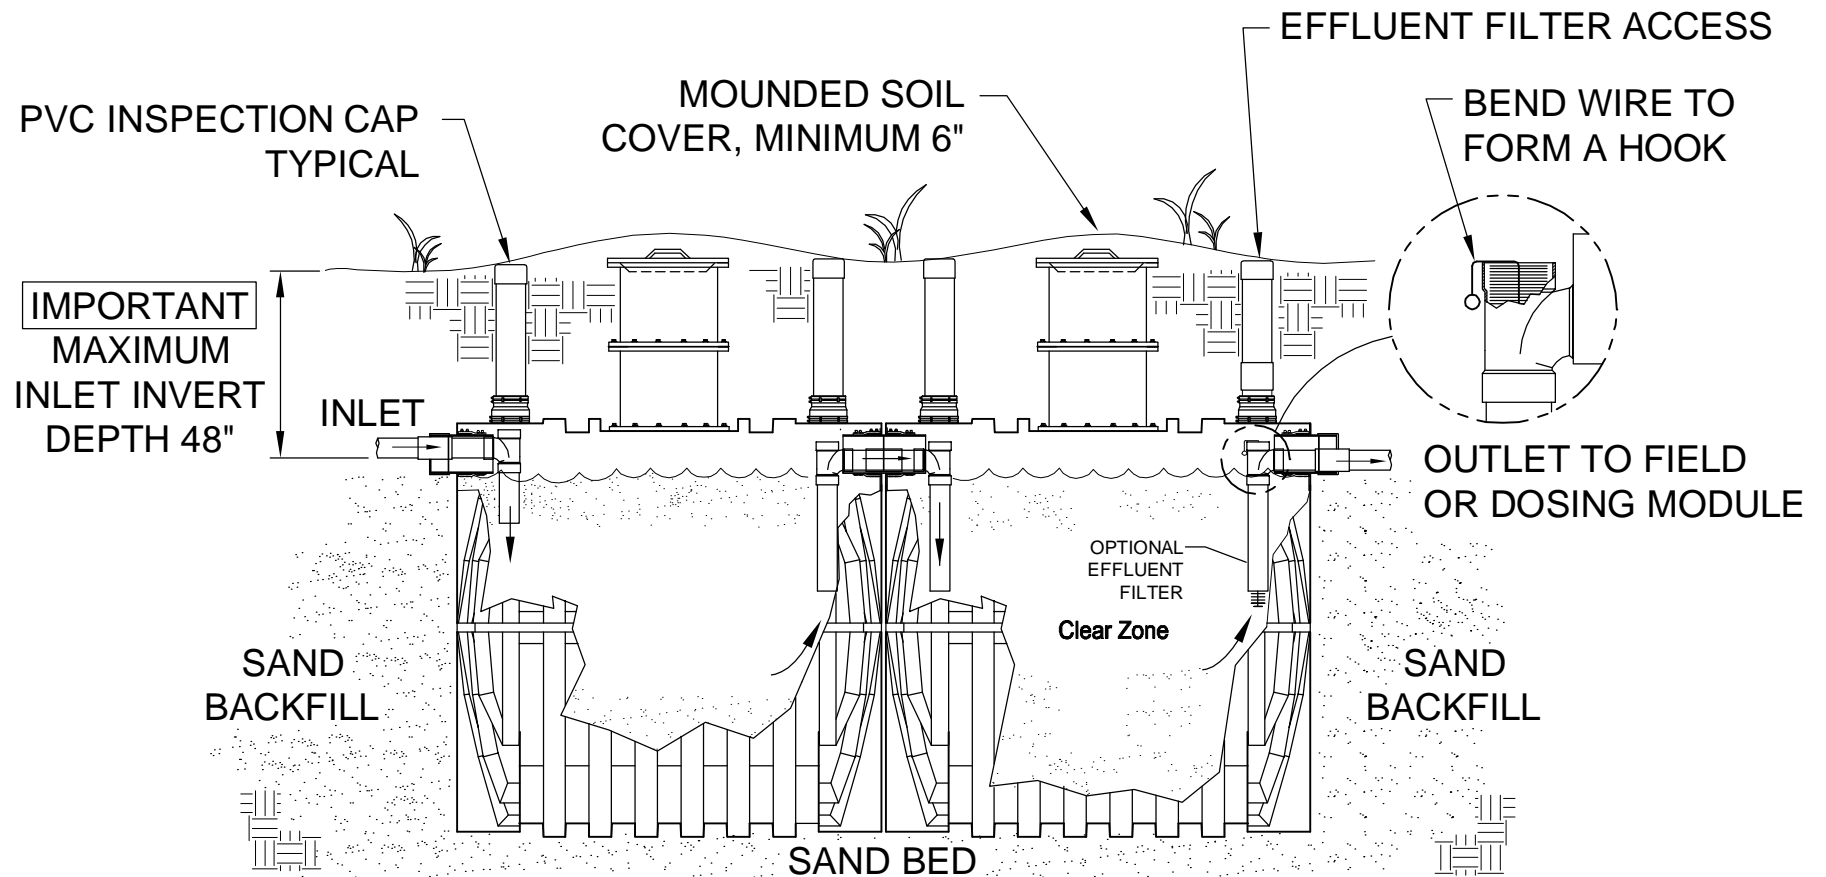

WARNING

WASTEWATER SYSTEMS MUST BE APPROVED IN ADVANCE BY THE LOCAL PUBLIC HEALTH DEPARTMENT PRIOR TO INSTALLATION.

NOT TO SCALE, FOR ILLUSTRATION ONLY

Darco Inc.
All Rights Reserved
5-3-10